


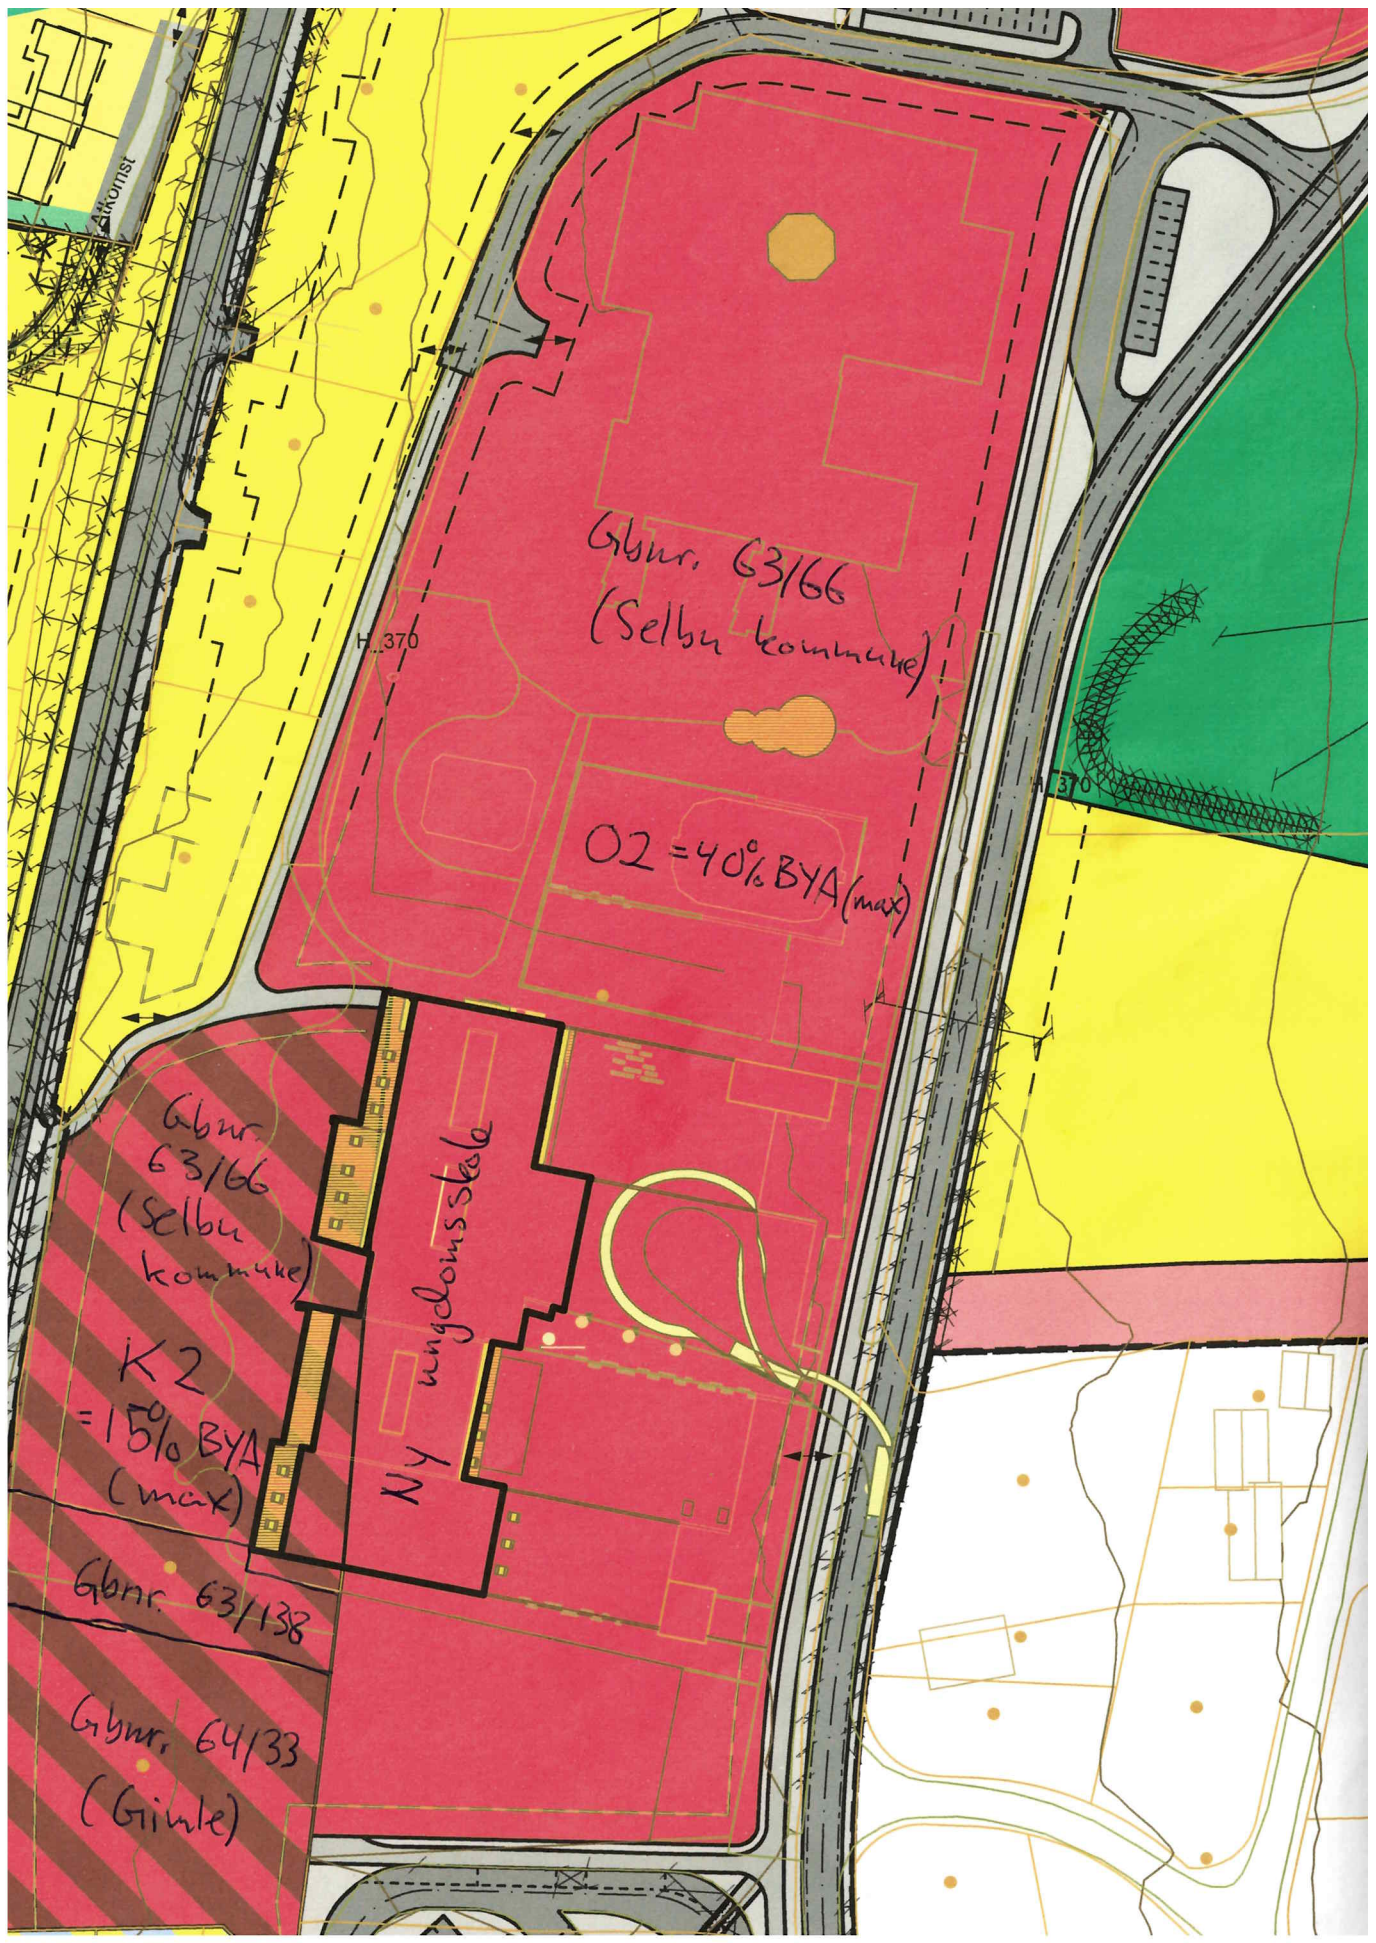

Gbnr. 63/66
(Selbu kommune)

O2 = 40% BYA (max)

Gbnr.
63/66
(Selbu
kommune)

K2
= 15% BYA
(max)

Gbnr. 63/138

Gbnr. 64/33
(Grinle)

Ny ungdomsskole